


0-600V, 400 Amps

CSA Certified, Class Pending

Fuse Mounting Bolt: 120 lbs-in

Catalog No.	"A"	"B"	"C"
FWA 70A-100A	50.3 (1.98)	8.9 (0.35)	167.9 (6.61)
FWH 125B-200B	70.4 (2.77)	29.0 (1.14)	188.0 (7.40)
KWX 125A-200A	61.2 (2.41)	19.8 (0.78)	178.8 (7.04)
KBC 110-200	94.0 (3.70)	52.6 (2.07)	211.6 (8.33)
70-100CJ	92.2 (3.63)	50.8 (2.00)	209.8 (8.26)
125-200M09C	111.3 (4.38)	69.9 (2.75)	228.9 (9.01)
250-400P09C*	111.3 (4.38)	69.9 (2.75)	228.9 (9.01)
JLS 110-200	63.5 (2.50)	22.1 (0.87)	181.1 (7.13)

*When used in multiple pole configurations, 19.05 (.750) should be maintained between adjacent moldings when mounting the fuses indicated.

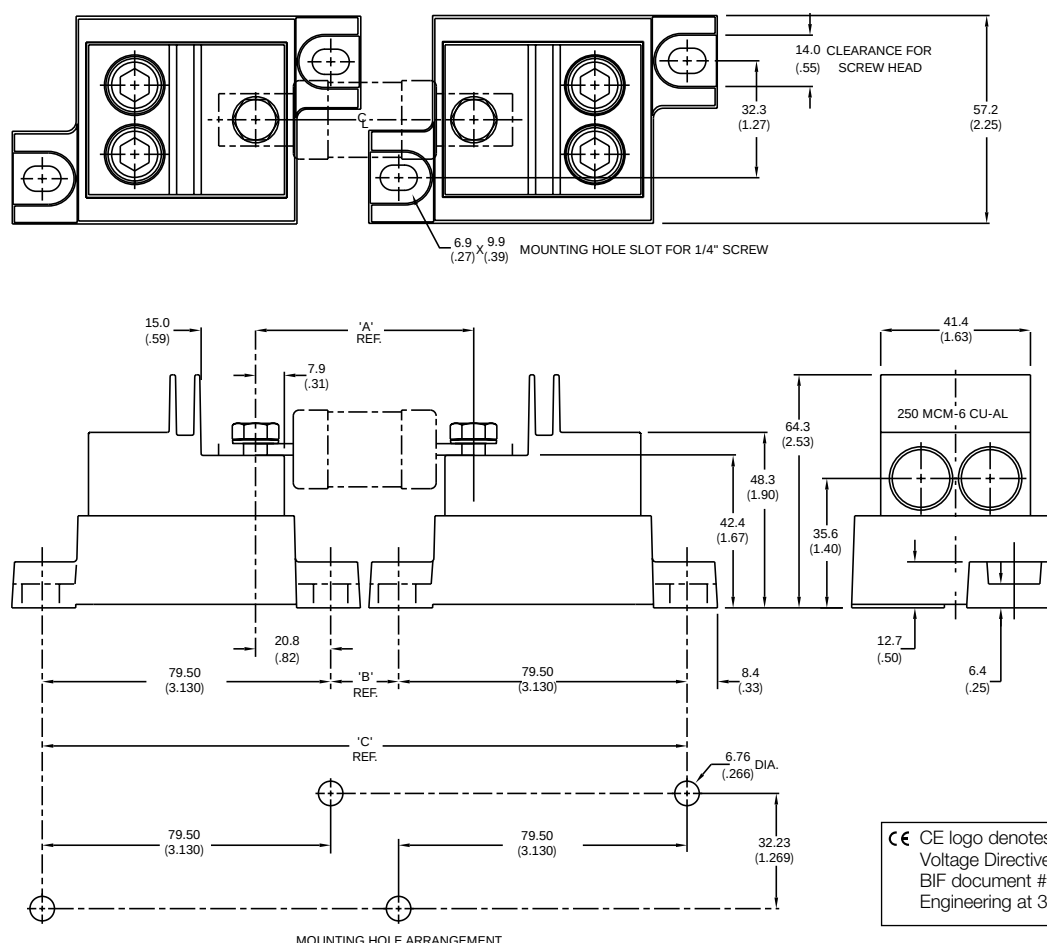

The only controlled copy of this BIF document is the electronic read-only version located on the Bussmann Network Drive. All other copies of this BIF document are by definition uncontrolled. This bulletin is intended to clearly present comprehensive product data and provide technical information that will help the end user with design applications. Bussmann reserves the right, without notice, to change design or construction of any products and to discontinue or limit distribution of any products. Bussmann also reserves the right to change or update, without notice, any technical information contained in this bulletin. Once a product has been selected, it should be tested by the user in all possible applications.