



Protection against contact with a finger, IP2X, 3p, size 3

**Part no.** NZM3-XIPK  
**Catalog No.** 266804

**EL-Nummer (Norway)** 0004358891

## Delivery program

|                      |  |  |                                               |
|----------------------|--|--|-----------------------------------------------|
| Accessories          |  |  | IP2X protection against contact with a finger |
| Number of conductors |  |  | 3 pole                                        |
| Accessories          |  |  | IP2X protection against contact with finger   |
| For use with         |  |  | NZM3, PN3, N3                                 |
| For use with         |  |  | For box terminal                              |

### Notes

Type contains parts for a terminal located at top or bottom for 3 or 4-pole circuit-breakers.

Enhancement of the protection against direct contact to IP2X.

Protection when reaching into the cable connection area with the connection of cables in the box terminal.

With 2 conductors maximum cross-section 70mm<sup>2</sup>.

Cannot be combined with NZM-XSTK control circuit terminal.

## Design verification as per IEC/EN 61439

|                                                                                                                        |  |  |                                                                                                                                  |
|------------------------------------------------------------------------------------------------------------------------|--|--|----------------------------------------------------------------------------------------------------------------------------------|
| IEC/EN 61439 design verification                                                                                       |  |  |                                                                                                                                  |
| 10.2 Strength of materials and parts                                                                                   |  |  |                                                                                                                                  |
| 10.2.2 Corrosion resistance                                                                                            |  |  | Meets the product standard's requirements.                                                                                       |
| 10.2.3.1 Verification of thermal stability of enclosures                                                               |  |  | Meets the product standard's requirements.                                                                                       |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat                                             |  |  | Meets the product standard's requirements.                                                                                       |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |  |  | Meets the product standard's requirements.                                                                                       |
| 10.2.4 Resistance to ultra-violet (UV) radiation                                                                       |  |  | Meets the product standard's requirements.                                                                                       |
| 10.2.5 Lifting                                                                                                         |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.2.6 Mechanical impact                                                                                               |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.2.7 Inscriptions                                                                                                    |  |  | Meets the product standard's requirements.                                                                                       |
| 10.3 Degree of protection of ASSEMBLIES                                                                                |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.4 Clearances and creepage distances                                                                                 |  |  | Meets the product standard's requirements.                                                                                       |
| 10.5 Protection against electric shock                                                                                 |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.6 Incorporation of switching devices and components                                                                 |  |  | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.7 Internal electrical circuits and connections                                                                      |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.8 Connections for external conductors                                                                               |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9 Insulation properties                                                                                             |  |  |                                                                                                                                  |
| 10.9.2 Power-frequency electric strength                                                                               |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9.3 Impulse withstand voltage                                                                                       |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.9.4 Testing of enclosures made of insulating material                                                               |  |  | Is the panel builder's responsibility.                                                                                           |
| 10.10 Temperature rise                                                                                                 |  |  | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating                                                                                             |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility                                                                                    |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function                                                                                              |  |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |

## Technical data ETIM 7.0


|                                                                                                                                                                                                                 |  |  |       |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--|-------|
| Low-voltage industrial components (EG000017) / Phase separation plate for power circuit breaker (EC002035)                                                                                                      |  |  |       |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Phase separation plate for circuit breaker (ecl@ss10.0.1-27-37-04-25 [ACN959011]) |  |  |       |
| Model                                                                                                                                                                                                           |  |  | Other |

## Approvals

North America Certification

UL/CSA certification not required

## Dimensions

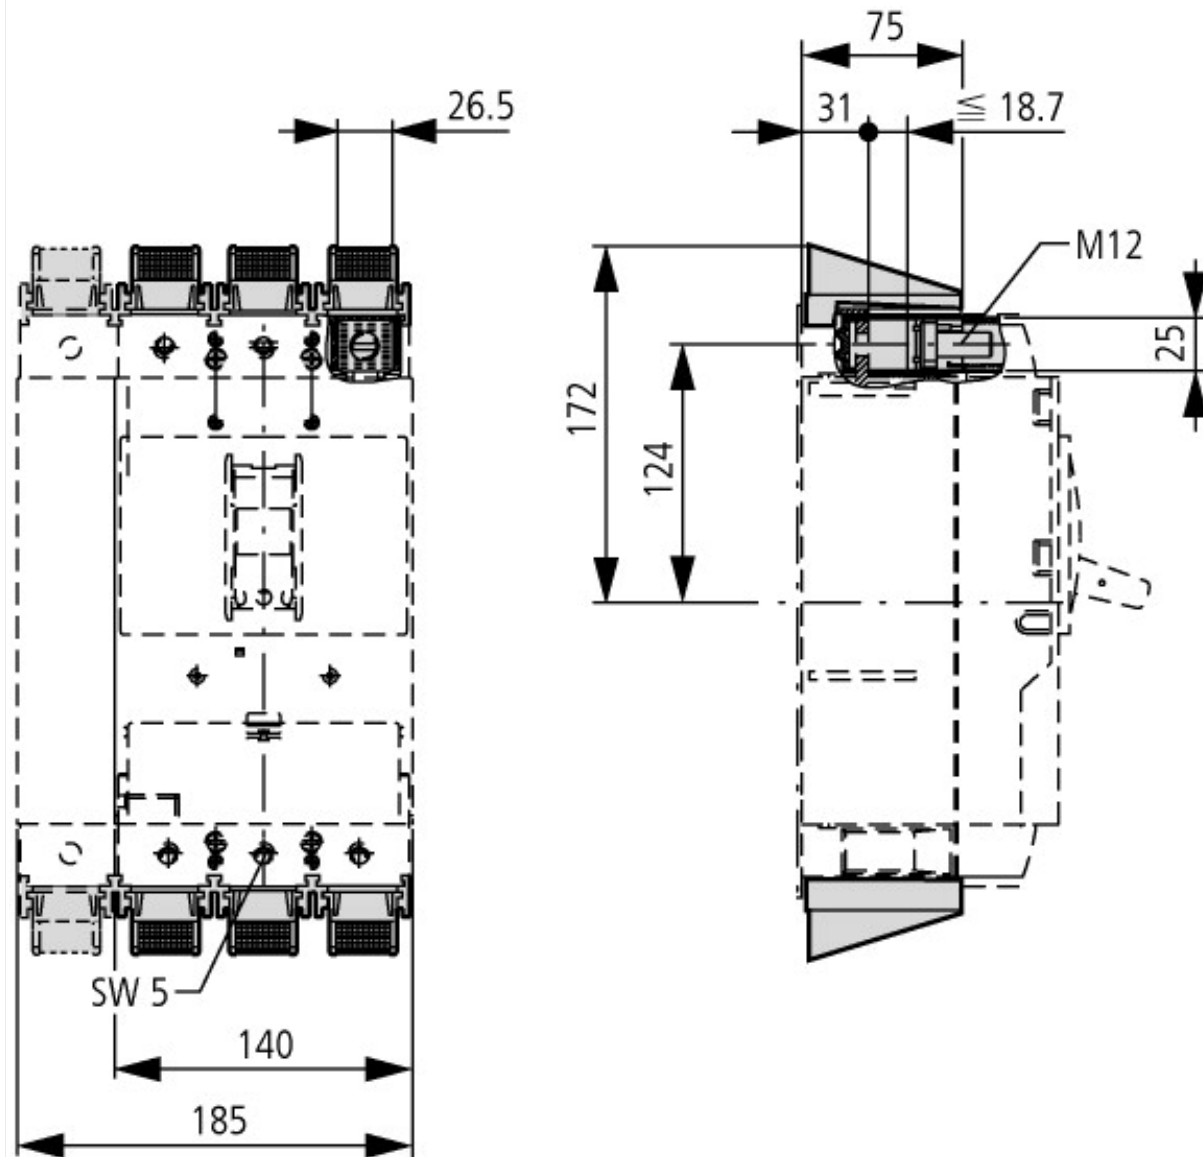

## Additional product information (links)

IL01219008Z (AWA1230-2057) IP2X fingerproof

IL01219008Z (AWA1230-2057) IP2X fingerproof [ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL01219008Z2018\\_11.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01219008Z2018_11.pdf)